Riverside County Flood Control

RFCWQ4 V26 Output 10/19/2007
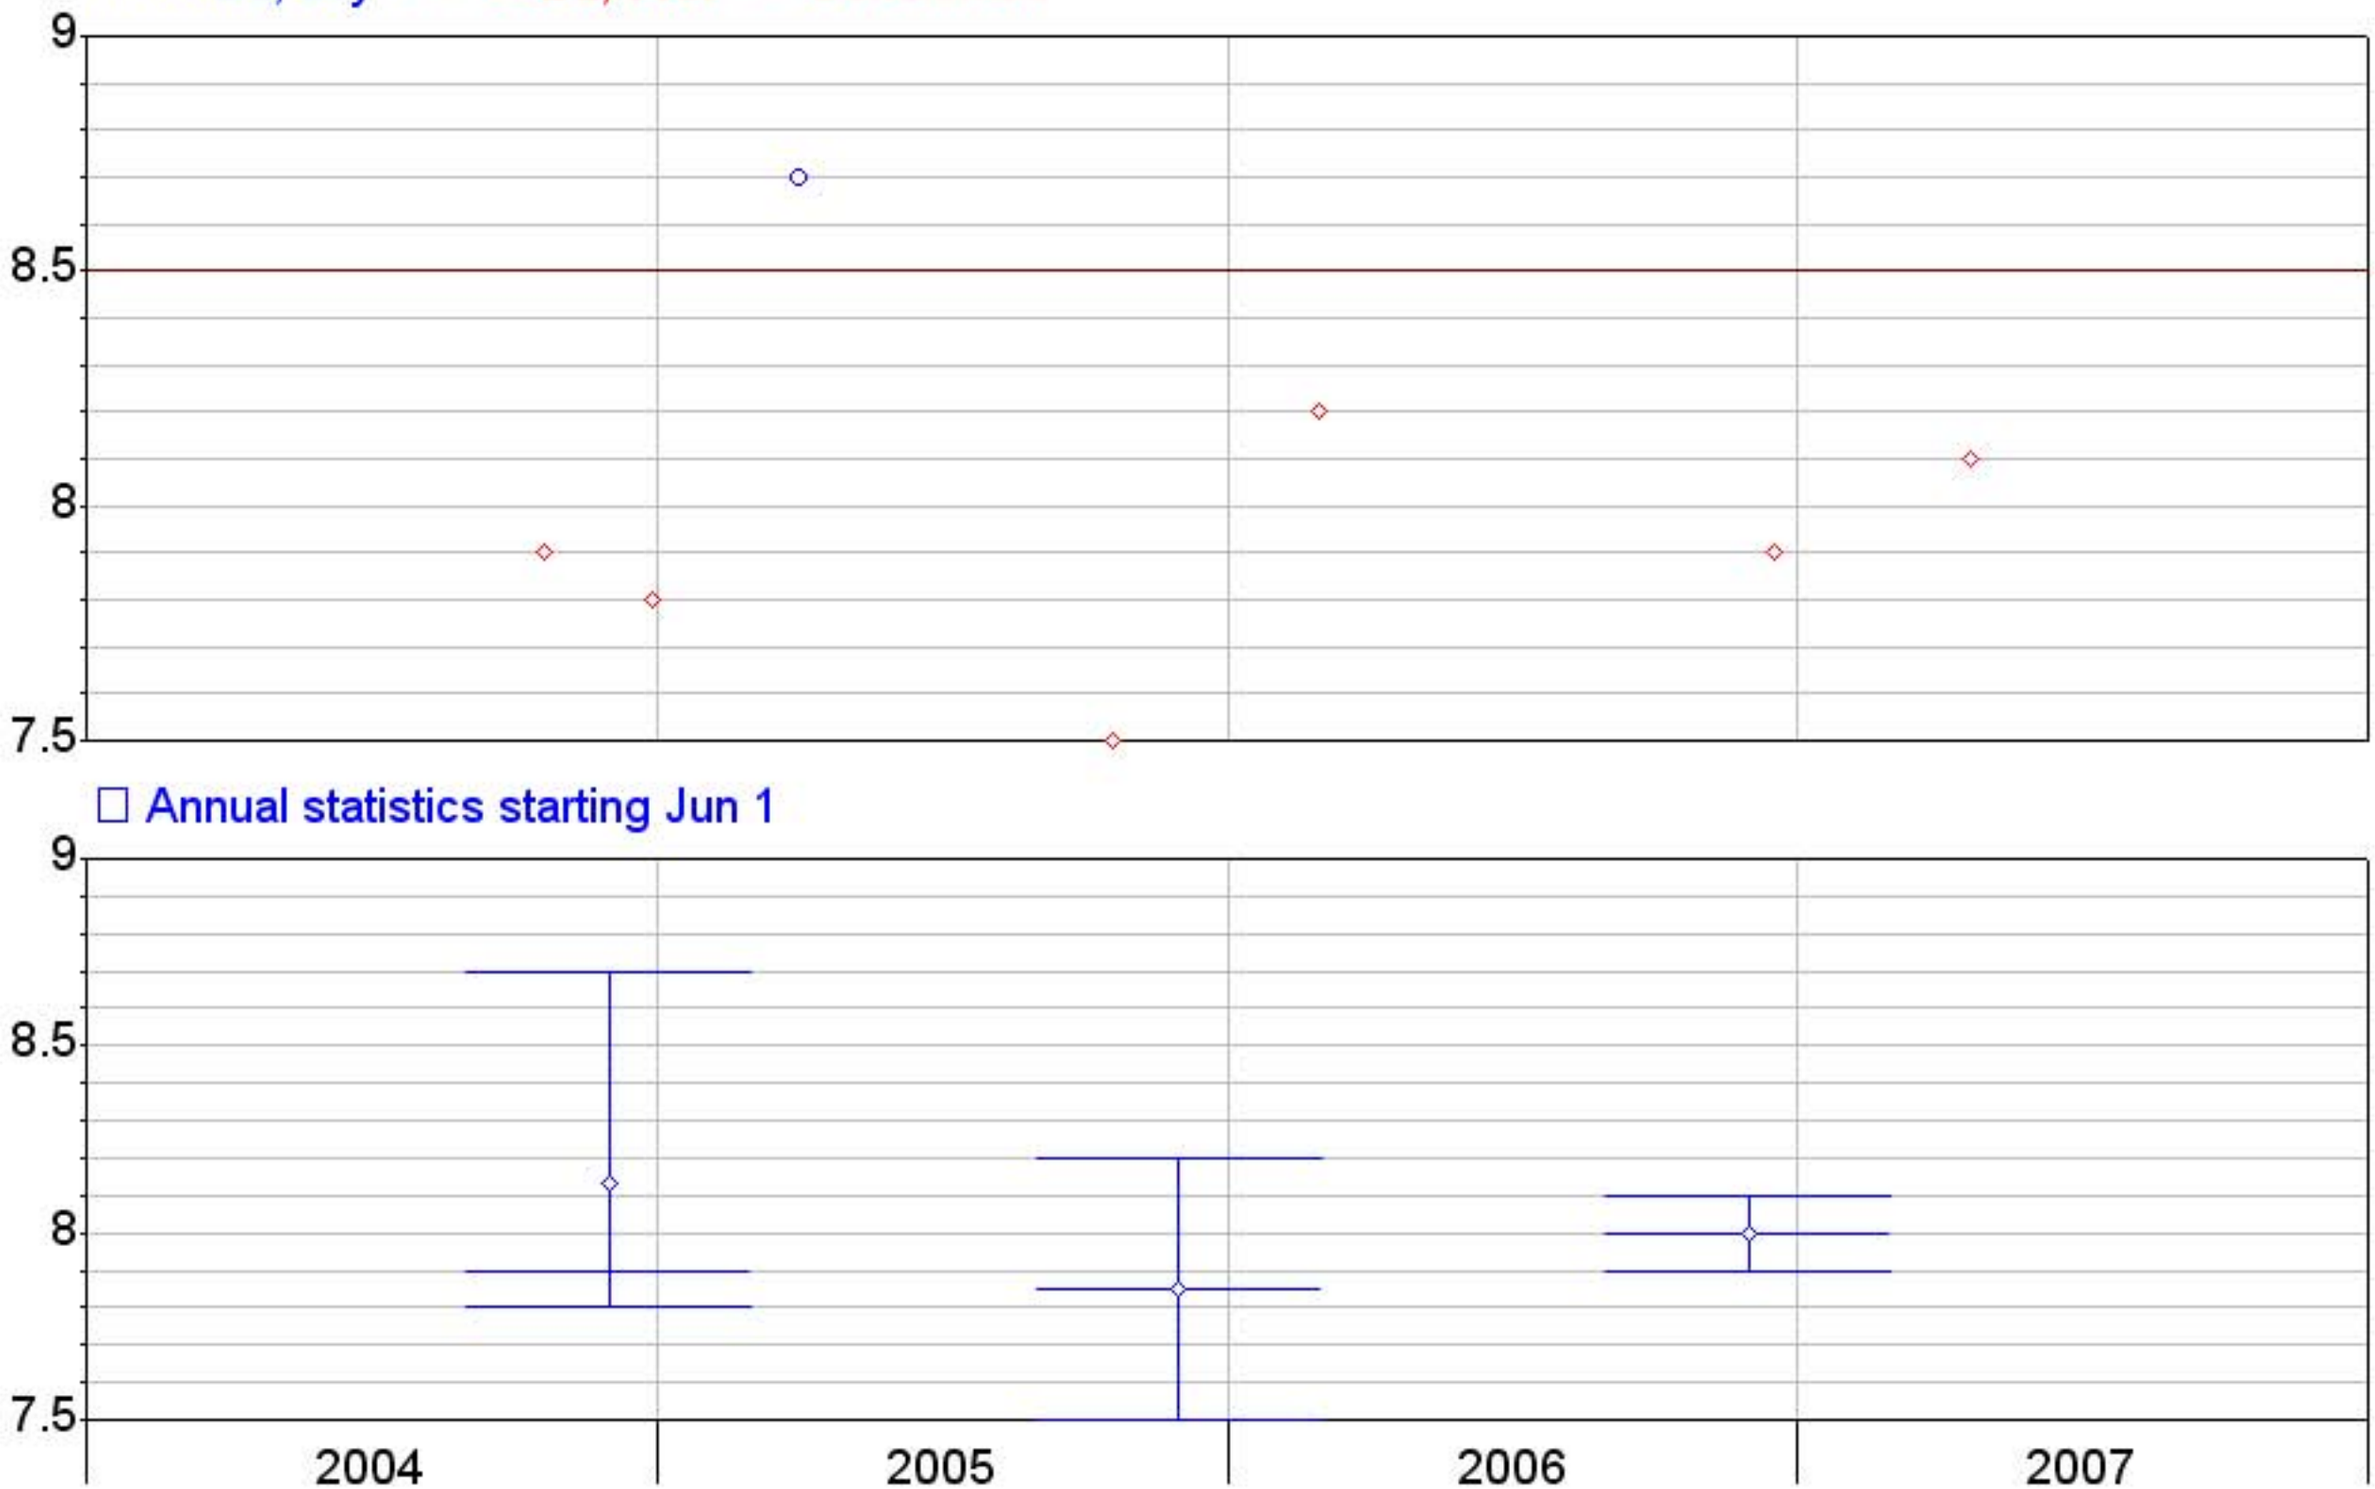
397 Warm Springs Creek near Murrieta
1710 pH, lab in Units
Benchmark 6.5..8.5, Source = BPO